
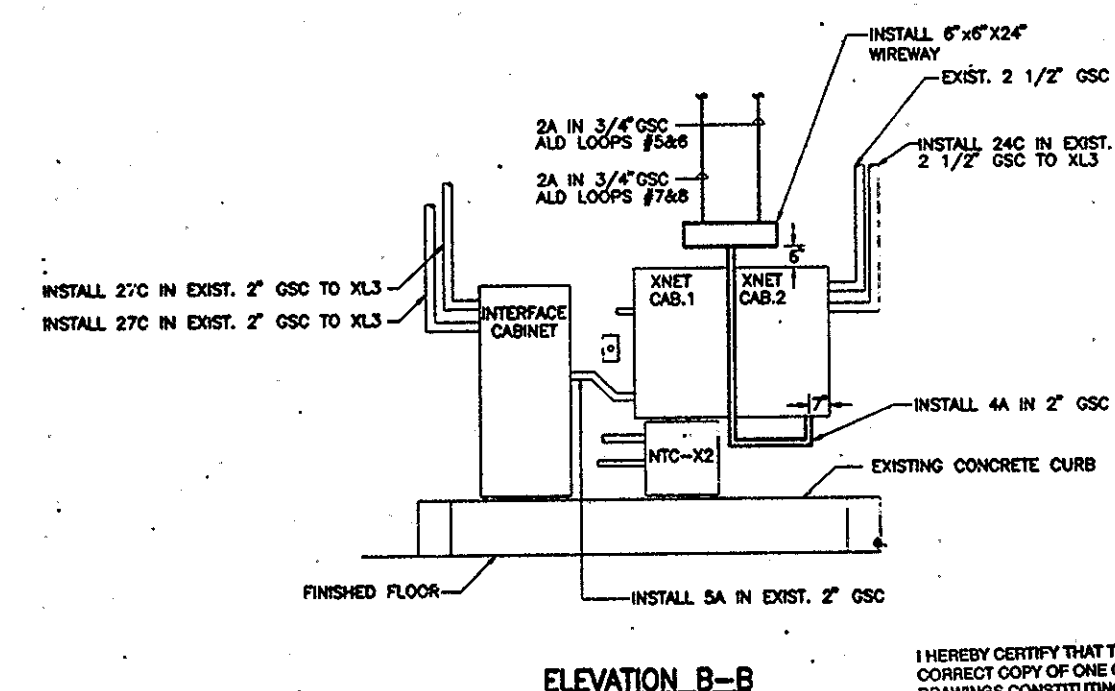


1 WTC 75th FLOOR MER PLAN

0 16 32
SCALE IN FEET


- NOTES:**
1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
 2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MCC AND INSTALL TRX-BB AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
 3. FOR 75th FLOOR MER RISER DIAGRAM, SEE DWG E-14.
 4. FOR 75th FLOOR MER REMOVAL PLAN, SEE DWG E-18.

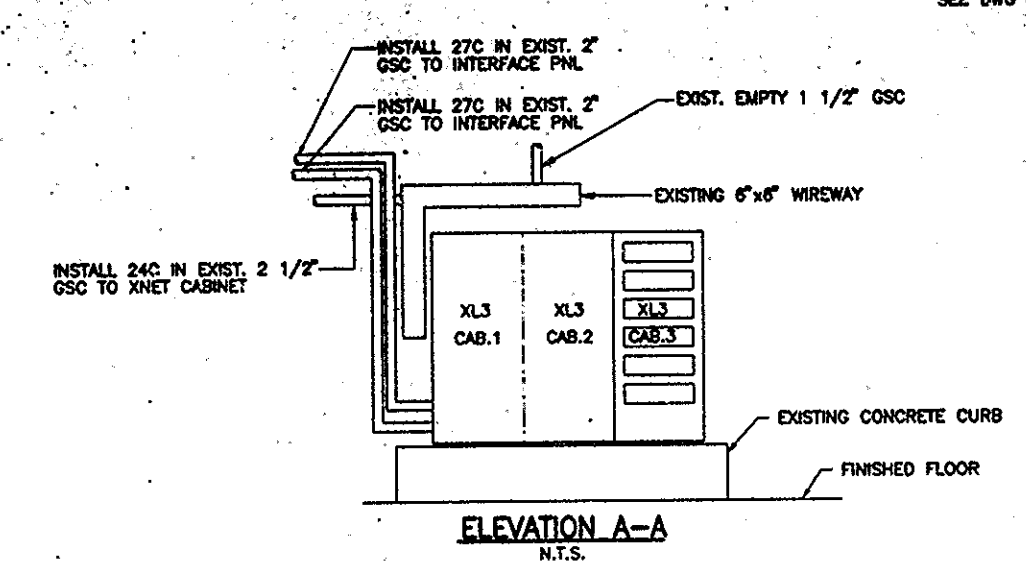

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861082 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 [Signature]
CONTRACT ENGR/ARCH.

DATE 2/1/00 [Signature]
ENGINEERING PROGRAM MGR.

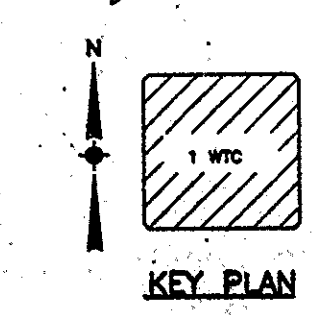

Sheet 17 of 18

THE WORLD TRADE CENTER
OF NY & NJ

[Signature]
ENGINEERING PROGRAM MANAGER
WORLD TRADE
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved
1			

Engineering Department
Design Division

The World Trade Center

Title

**FIRE ALARM SYSTEM
PHASE II
XLS CONVERSION
ELECTRICAL
1 WTC
75th FLOOR MER
PLAN**

This drawing subject to conditions & general notes herein are reserved to Port Authority and may not be used without its written permission.

ROYZMAN
FELDMAN
Designed by

ROYZMAN
FELDMAN
Drawn by

Checked by

Date 5-20-99 Scale AS NOTED

Contract Number WTC-861082 Drawing Number 6-15